
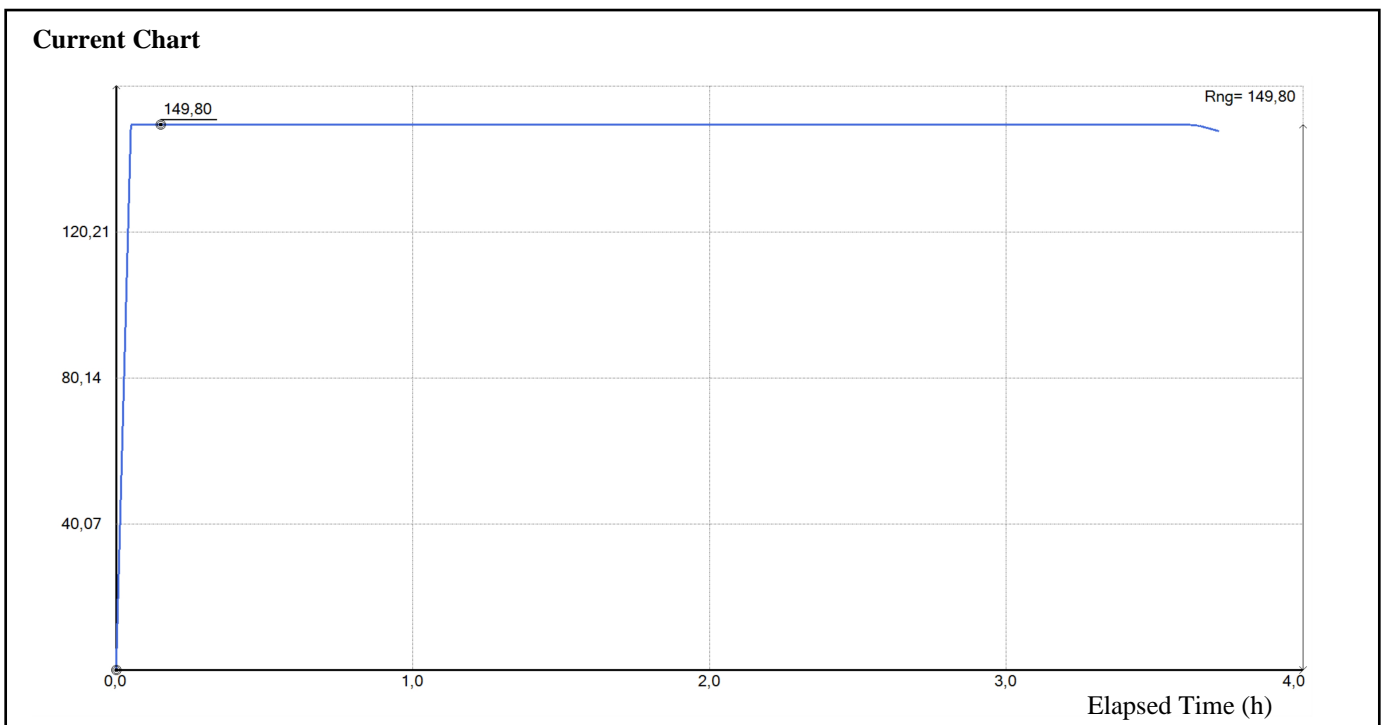


BATTERY DISCHARGE REPORT

Customer Name	Leyers Lagertechnik
Operator Name	Nils Leyers
Battery identification	IBH
Cell Voltage (V)	80
Cell Number	40
Battery Capacity (Ah)	775
DISCHARGE SETTING	
Current (A)	150,00
Minimum battery voltage (V)	68,00
Maximum time (m)	UNLIMITED
Serial number	373406
Sampling Time (s)	180
Firmware Revision	190
TEST RESULTS	
Starting time	18.06.2026 12:05:48
Discharged capacity (Ah)	556,40
Total time of discharge	3h43'
Initial battery voltage (V)	89,29
Final battery voltage (V)	67,98
Ending condition	END_CYCLE_VBATT_LOW

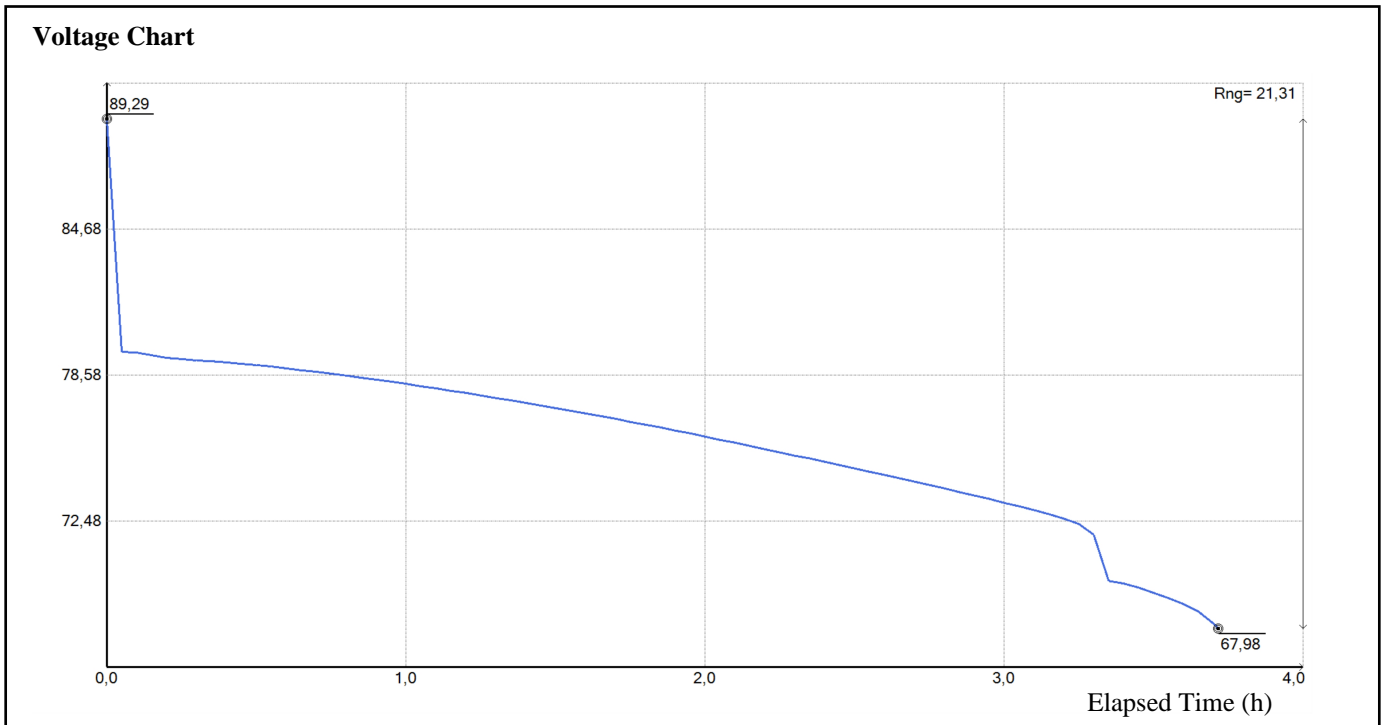

Report Notes