



UTSK minimum distances

240L ash bin

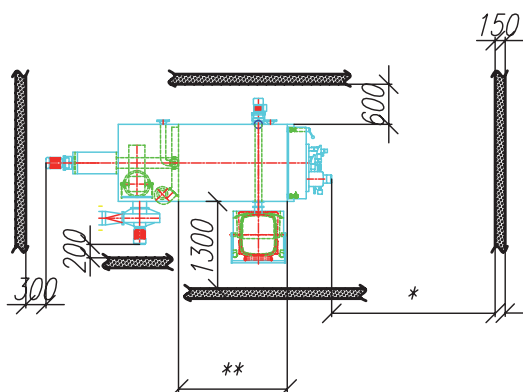


800L ash bin

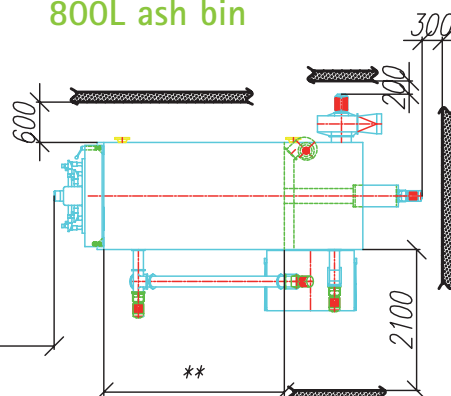

*The minimum distance for opening the heat exchanger door is equivalent to the width of the boiler, but

**for maintenance reasons we recommend a clear space, equivalent to the length of the heat exchanger, is left in front of the boiler - outward opening plant room doors in front of boiler can help achieve space required.

Data sheet HPKI-K 180-2000 kW

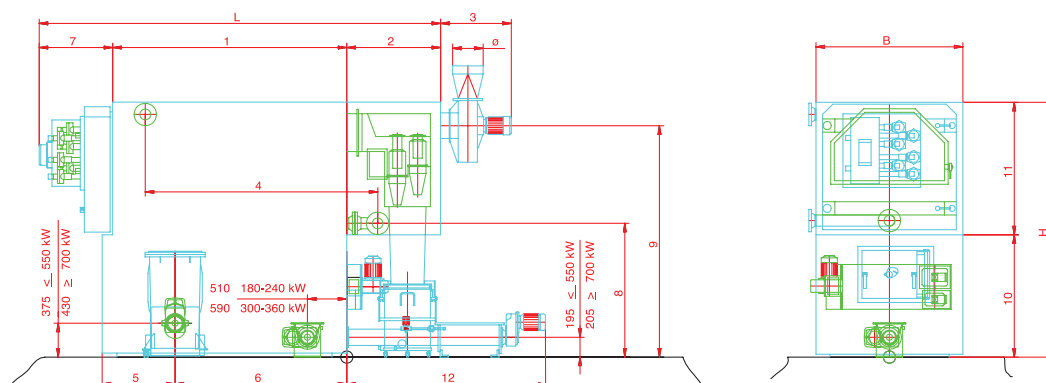

Output in kW	L	B	H	1	2	3	4	5	6	7	8	9	10	11	12	Flow/return DN	Ø mm	Total weight in tons	Weight heat exchanger in tons	Water in litre	Kpa at 120°C	Kvs in m³/h
180	2990	1150	2200	1600	720	590	1450	530	1170	670	1150	1970	1050	1150	2000	65	180	3.10	1.32	830	2.6	48
240	3190	1150	2200	1600	920	590	1580	530	1170	670	1150	1970	1050	1150	2200	65	200	3.20	1.32	830	4.6	48
300	3450	1250	2250	1800	920	590	1810	500	1400	730	1160	1990	1050	1200	2200	80	200	4.00	1.74	1100	3.2	72
360	3450	1250	2250	1800	920	670	1810	500	1400	730	1160	1990	1050	1200	2200	80	250	4.00	1.74	1100	4.6	72
450	3950	1440	2480	2300	920	670	2290	716	1684	730	1320	2270	1200	1280	2200	100	300	6.00	2.45	1550	3	110
550	3950	1440	2480	2300	920	670	2290	716	1684	730	1320	2270	1200	1280	2200	100	300	6.00	2.45	1550	4.6	110
700	4620	1600	3000	2700	1180	770	2690	762	2038	740	1585	2740	1450	1550	2438	100	360	9.00	4.62	2550	2.7	182
900	4620	1600	3000	2700	1180	870	2690	762	2038	740	1585	2740	1450	1550	2438	100	360	9.00	4.62	2550	4.5	182
1200	4990	1800	3500	3000	1230	870	3030	843	2257	760	1885	3190	1750	1750	2490	125	400	11.80	5.94	3450	3.3	283
1600	5590	1800	3550	3400	1430	870	3430	865	2635	760	1900	3240	1750	1800	2700	150	-	14.00	7.68	3650	3.6	363
2000	6250	2000	3950	3800	1660	-	3870	905	2995	790	2185	-	2000	1950	3027	200	-	19.00	9.63	5200	3.1	485